



Room Description: TX Room PRK / LASIK (TREY3)

NSF: 240


TREY3

Sheet Description: Room/Equipment Isometric

Scale:

Sheet
1

of
5

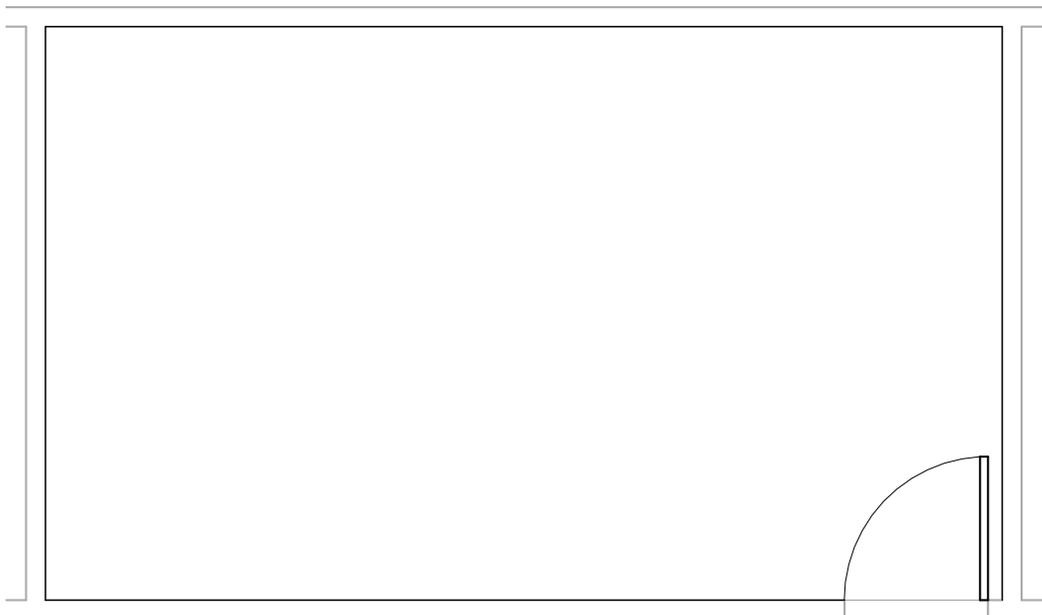


TREY3 - CEILING MOUNTED EQUIPMENT PLAN

NOTES:

1. Provide battery backup for all light fixtures.
2. Coordinate with equipment manufacturer for any electronic ballast interference.


Room Description: TX Room PRK / LASIK (TREY3)	NSF: 240	TREY3	
Sheet Description: Ceiling Mounted Equipment Plan	Scale: 1/4" = 1'-0"	Sheet 2	of 5

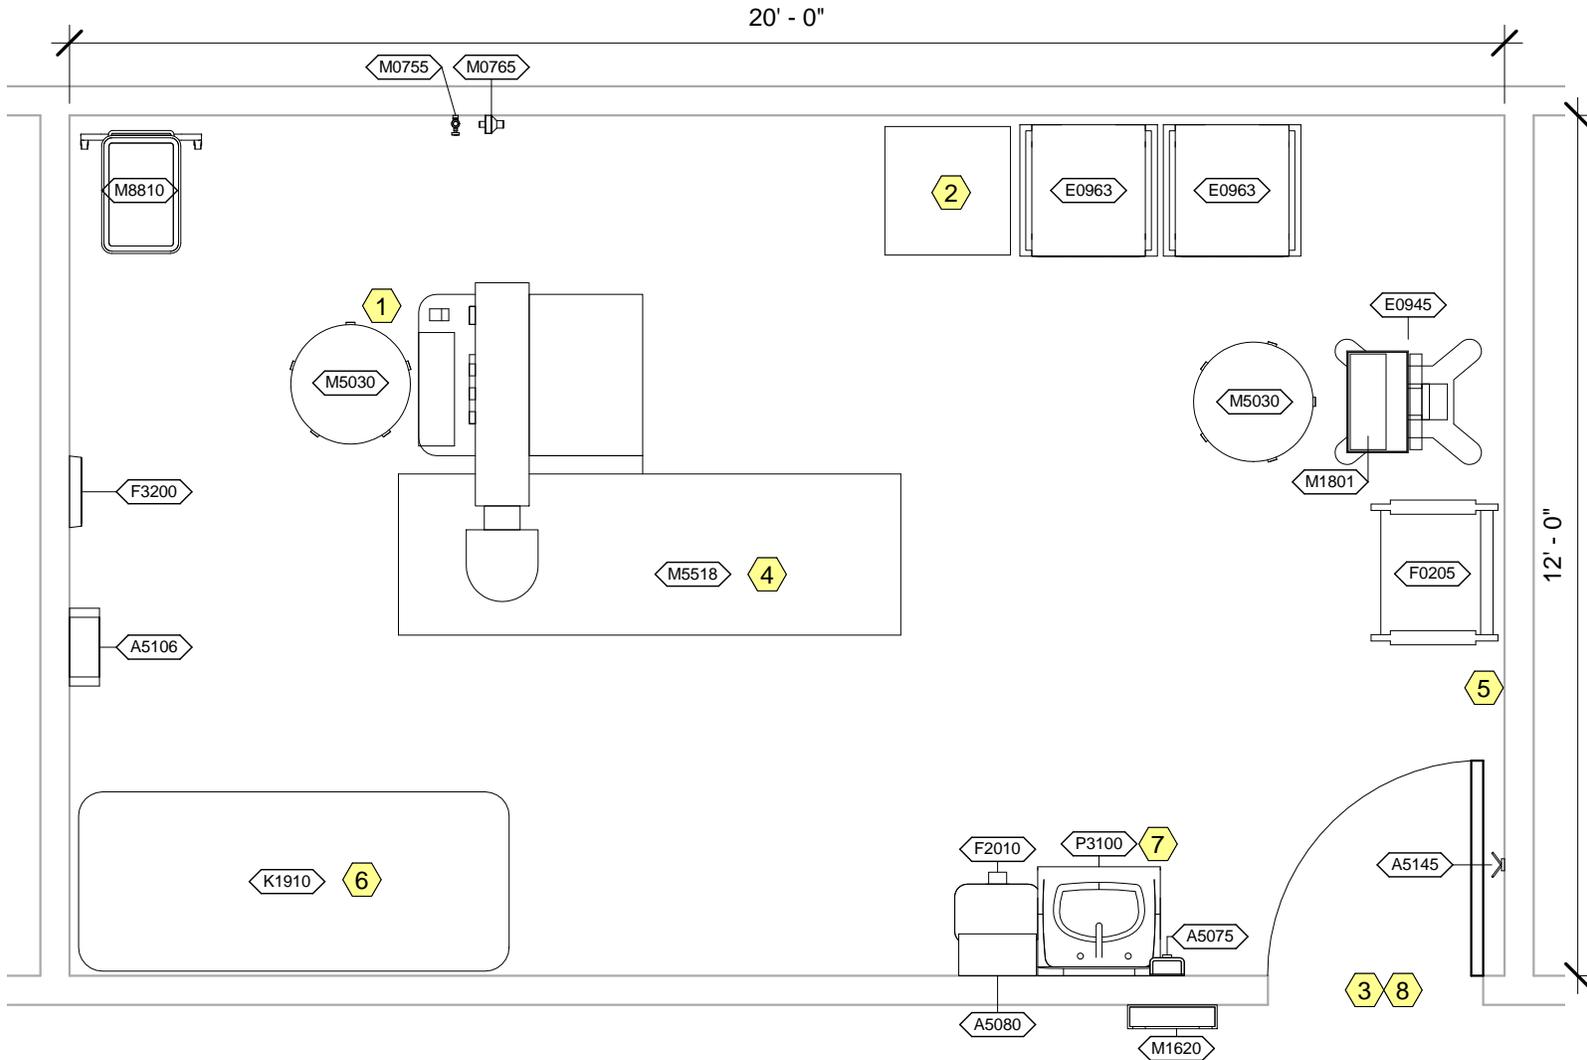

TREY3 - NOTES

- 1 A second monitor, local or remote, is optional.
- 2 Room air purifier.
- 3 Provide electronic access system for door.
- 4 A reclining chair may be used instead of JSN M5518, Laser, Corneal Exam Table
- 5 Visual temperature and humidity gauges. Sensors and visual gauges may be combined in a single unit. Mount top of gauges at 4'-6" A.F.F.
- 6 JSN K1910, Table, Work, Stainless Steel, shown as 72"W x 24"D, shall include casters.
- 7 JSN P8710, Utility Center, shall be included in Navy projects only.
- 8 Service specific room status system may be required.


Room Description: TX Room PRK / LASIK (TREY3)	NSF: 240	<h1>TREY3</h1>	
Sheet Description: Equipment Plan	Scale: 3/8" = 1'-0"	Sheet <h2>3</h2>	of <h2>5</h2>

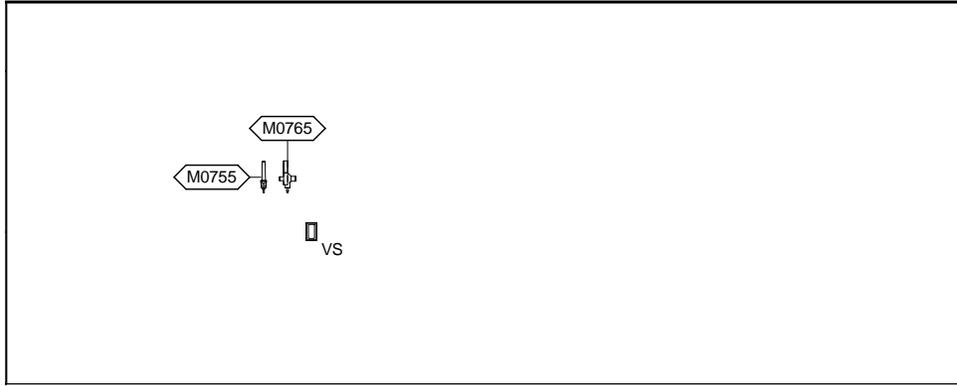


TREY3 - NORTH ELEVATION



TREY3 - EAST ELEVATION

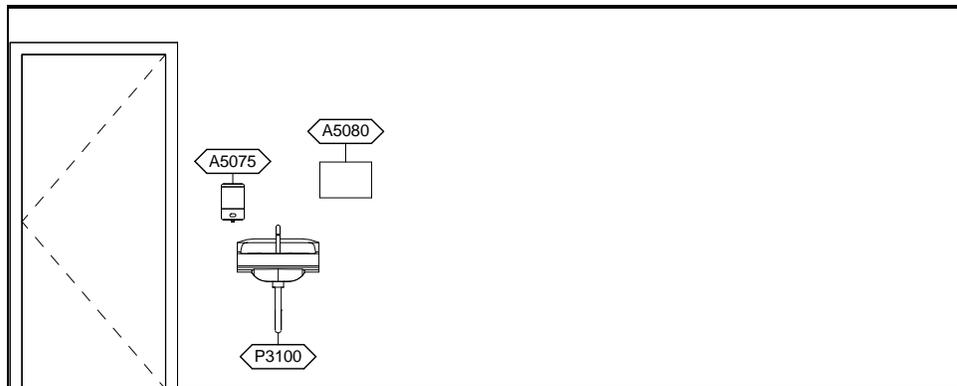

TREY3 - SOUTH ELEVATION

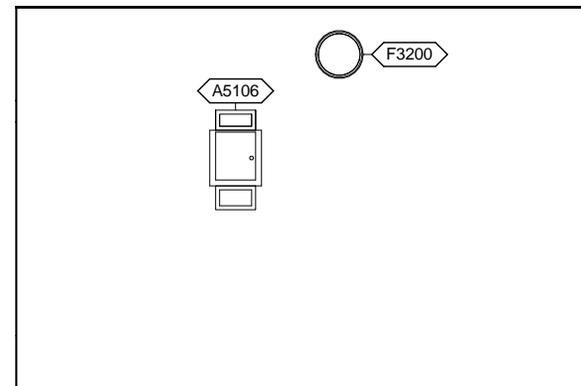

TREY3 - WEST ELEVATION

Room Description: TX Room PRK / LASIK (TREY3)	NSF: 240	<h1>TREY3</h1>	
Sheet Description: Interior Room Elevations	Scale: 1/4" = 1'-0"	Sheet <h2>4</h2>	of <h2>5</h2>

TREY3 - EQUIPMENT SCHEDULE

JSN	Nomenclature	Qty	LF	AR	Logistics			Utilities						
					NA	AF	VA	1	2	3	4	5	6	
A5075	Dispenser, Soap, Disposable	1		C	C	C	C	-	-	-	-	-	-	-
A5080	Dispenser, Paper Towel, SS, Surface Mounted	1		A	A	A	A	-	-	-	-	-	-	-
A5106	Waste Disposal Unit, Sharps w/Glove Dispenser	1		C	A	C	C	-	-	-	-	-	-	-
A5145	Hook, Garment, Double, SS, Surface Mounted	1		A	A	A	A	-	-	-	-	-	-	-
E0945	Mobile, Workstation	1		C	C	C	C	-	-	-	-	-	-	-
E0963	Cart, General Storage, Mobile	2		C	C	C	C	-	-	-	-	-	-	-
F0205	Chair, Side With Arms	1		C	C	C	C	-	-	-	-	-	-	-
F2010	Basket, Wastepaper, Step-On	1		C	C	C	C	-	-	-	-	-	-	-
F3200	Clock, Battery, 12" Diameter	1		C	C	C	C	-	-	-	-	-	-	-
K1910	Table, Work, Stainless Steel	1		A	A	A	A	-	-	-	-	-	-	-
M0755	Flowmeter, Oxygen, Low Flow	1		C	C	C	C	-	-	A	-	-	-	-
M0765	Regulator, Vacuum	1		C	C	C	C	-	-	B	-	-	-	-
M1620	Holder, Chart, Patient, Wall or Door Mounted	1		A	A	A	A	-	-	-	-	-	-	-
M1801	Computer, Microprocessing, w/Flat Panel Monitor	1		C	C	C	C	-	A	-	-	-	-	-
M5030	Stool, Surgeon, Revolving	2		C	C	C	C	-	-	-	-	-	-	-
M5518	Laser, Corneal Surgery	1		C	C	C	C	-	F	-	-	-	-	-
M8810	Stand, Mayo	1		C	C	C	C	-	-	-	-	-	-	-
P3100	Lavatory, Vitreous China, Slab Type	1		A	A	A	A	D	-	-	-	-	-	-

Room Description: TX Room PRK / LASIK (TREY3)	NSF: 240	<h1>TREY3</h1>	
Sheet Description: Equipment Schedule	Scale:	Sheet <h2>5</h2>	of <h2>5</h2>